



# **Pressure Reducing Valves**

The Singer models 106-PR / 206-PR Pressure Reducing Valves sense the downstream pressure through a connection at the valve outlet. Under flowing conditions, the pilot reacts to small changes in pressure to maintain a steady downstream pressure.



TECHNICAL GUIDE: AVH1.8

## **Applications**

Potable water

Municipal

Mining Applications

Irrigation Applications

Water loss management

#### **Product Attributes**

Ideal for maintaining accurate downstream pressure

Responds quickly and effectively

## Approvals/Standards

AS 5081:2008

Flanges to AS/NZS 4087 Fig. B5

Coating complies with AS/NZS 4158



# The Singer Pressure Reducing Valves are based on the 106-PG or 206-PG main valves and are configurable to suit your application.

The pilot valves sense the downstream pressure through a connection at the valve outlet. Under flowing conditions, the pilot reacts to small changes in pressure to control the valve position by modulating the pressure above the diaphragm. The downstream pressure is maintained virtually steady at the pilot set-point.

In typical pressure reducing applications, the reduced port model 206-PR is often the best selection.

#### **STANDARD MATERIALS**

Standard materials for pilot system components are:

- ASTM B62 bronze or ASTM B16 brass
- AISI 303 / 316 stainless steel trim
- Buna-N / EPDM diaphragm and seals

#### **SELECTION SUMMARY**

- 1. Select the valve series and size with sufficient capacity
- 2. Check the operating flow against valve minimum.
- 3. If the outlet pressure is less than 35% of the inlet pressure, check for cavitation.
- 4. Ensure that the flange rating exceeds the maximum operating pressure.


Refer to the Singer Control Valve Sizing Calculator on our website for assistance.

for possible bypass during maintenance.

#### **ORDERING INSTRUCTIONS**

Refer to the order form and ordering instructions. Additionally, include the following information for this product:

- 1. Single chamber (106) or (206)
- 2. Outlet pressure range

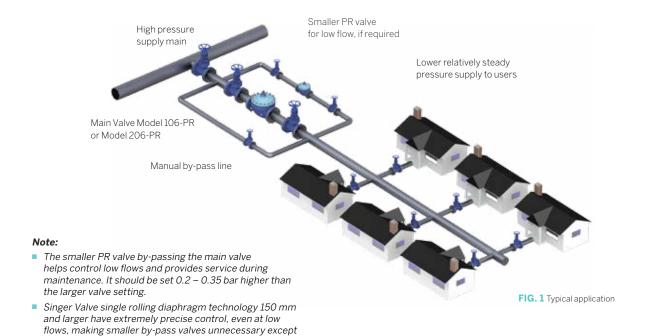

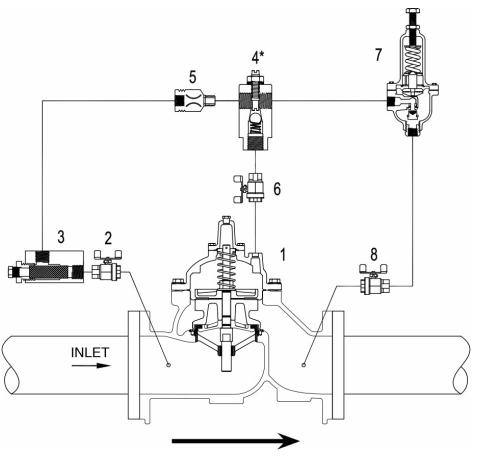


FIG. 2 Schematic A-0306C

# **SCHEMATIC DRAWING**

- 1. Main Valve 106-PG or 206-PG
- 2. Isolation Valve standard 100 mm and larger
- 3. Strainer standard 100 mm and larger
- 4. Model 26 Flow Stabilizer / Opening Speed Control
  - Standard on valves 200mm 106, 250mm 206 and smaller
- 5. Fixed Restriction
- 6. Isolation Valve standard 100 mm and larger
- 7. Model 160 pilot. Specify for:
  - 0.35 to 3.5 Bar
  - 0.70 to 5.5 Bar
  - 1.38 to 13.8 Bar
  - 6.9 to 20.7 Bar
- 8. Isolation Valve standard all sizes

**Note:** Singer Rolling Diaphragm shown is available for 150mm 106-PG and larger.

#### TABLE 1 106-PR

Code	Size (mm)	Minimum Flat Diaphragm (L/s)	Maximum Continuous (L/s)
Indent	15	0.1	0.8
Indent	19	0.1	1
Indent	25	0.1	3
Indent	32	0.1	6
Indent	40	0.1	8
CV050PRV106-PR-ESS	50	0.3	13
Indent	65	0.3	19
CV080PRV106-PR-ESS	80	0.3	29
CV100PRV106-PR-ESS	100	0.6	50

#### **TABLE 2** 106-PR

Code	Size (mm)	Minimum Flat Diaphragm (L/s)	Minimum Rolling Diaphragm (L/s)	Maximum Continuous (L/s)
CV150PRV106-PR-ESS	150	1.3	0.1	114
CV200PRV106-PR-ESS	200	2.5	0.1	196
CV250PRV106-PR-ESS	250	-	0.2	309
CV300PRV106-PR-ESS	300	-	0.2	442
CV350PRV106-PR-ESS	350	-	0.2	536
CV400PRV106-PR-ESS	400	-	0.2	694
Indent	500	-	0.6	1104
Indent	600	-	0.6	1628
Indent	900	-	1.3	3500

#### TABLE 3 206-PR

Code	Size (mm)	Minimum Flat Diaphragm (L/s)	Minimum Rolling Diaphragm (L/s)	Maximum Continuous (L/s)
CV080PRV206-PR-ESS	80	0.3	-	19
CV100PRV206-PR-ESS	100	0.3	-	37
CV150PRV206-PR-ESS	150	0.6	-	65
CV200PRV206-PR-SM	200	1.3	-	145
CV250PRV206-PR-ESS	250	2.5	-	260
CV300PRV206-PR-ESS	300	-	0.2	404
Indent	400	-	0.2	582
Indent	450	-	0.2	1040
Indent	500	-	0.2	1040

# **TABLE 4** 206-PR

Code	Size (mm)	Minimum Rolling Diaphragm (L/s)	Maximum Continuous (L/s)
Indent	600 x 400	0.2	1041
Indent	600 x 500	0.2	1370
Indent	700	0.6	2120
Indent	700	0.6	2123
Indent	800	0.6	2126
Indent	900	0.6	2132
Indent	1000	0.6	3912

 $<sup>\</sup>hbox{\it *Refer to 106-PG (AVH 1.11) and 206-PG (AVH 1.13)} \ Main \ Body \ Technical \ Guides \ for \ more \ information.$ 



Scan for more information

**Disclaimer**: While every effort has been made to ensure that the information in this document is correct and accurate, users of Hygrade Water Infrastructure product or information within this document must make their own assessment of suitability for their particular application. Product dimensions are nominal only, and should be verified if critical to a particular installation. No warranty is either expressed, implied, or statutory made by Hygrade Water Infrastructure unless expressly stated in any sale and purchase agreement entered into between Hygrade Water Infrastructure and the user.

September 2025

